



**NOTES:**

1. ELEVATION OF BELOW GRADE DUCTWORK AS REQUIRED TO MAKE CONNECTION WITH EXISTING 20" FOUL AIR DUCT.
2. DUCT AND FAN HOUSING DRAINS NOT SHOWN FOR CLARITY.
3. LOCATION OF LOW POINT. ALL BELOW GRADE DUCTWORK SHOULD DRAIN TOWARDS THIS POINT, THE JUNCTION CHAMBER, OR THE WET WELL.

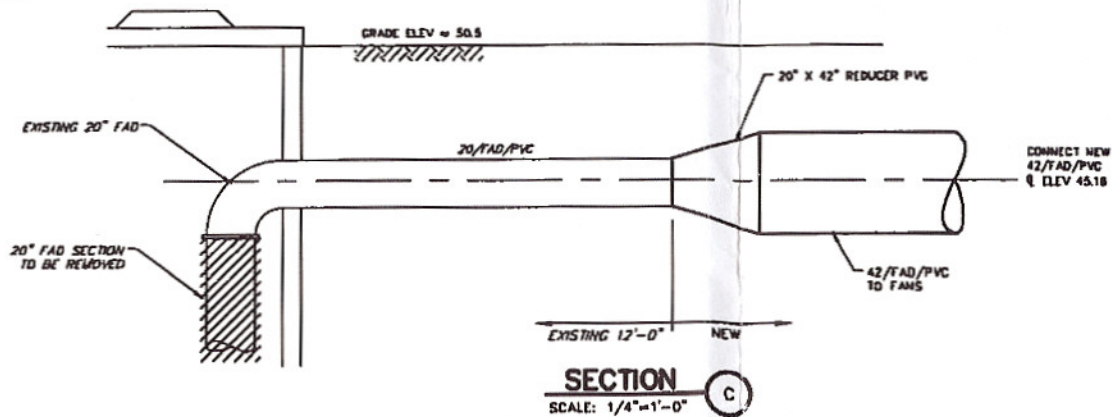



NO.	DATE	REVISION	BY
APAI NO.	1102-004-02	DRAWN BY:	
ISSUE DATE:		CHECKED BY:	

TO ARRANGE FOR LINES TO BE TURNED OFF OR MOVED, CALL CENTERPOINT AT 713-207-2222.

**PRIVATE UTILITY LINES SHOWN**

AT LEAST 48 HOURS BEFORE EXCAVATING IN STREET R.O.W. OR EASEMENTS CALL THE LONE STAR NOTIFICATION 713-223-4587

Date: \_\_\_\_\_

CenterPoint Energy/Electric Facilities  
Signature indicates underground electric lines are properly shown. No approval for construction is given.


Date: \_\_\_\_\_

Approved for SBC underground conduit facilities only.  
Signature valid for one year.

Date: \_\_\_\_\_

CenterPoint Energy/Gas Facilities/ENTEX Incorporated  
(Gas service lines are not shown)

**CABLE COMPANY**



SURVEYED BY:  
FB NO. 00000

ALAN PLUMMER ASSOCIATES, INC.  
P-13




**CITY OF HOUSTON**  
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

**11TH STREET ODOR CONTROL FACILITY**  
**ODOR CONTROL SYSTEM SECTIONS**

**ODOR CONTROL SYSTEM**

WBS NUMBER	FOR CITY OF HOUSTON USE ONLY
R-000020-0010-4	
DRAWING SCALE	
1/4" = 1'-0"	
CITY OF HOUSTON PM	
AKHTER HUSSAIN, P.E.	
DWG NO.: OC-003	
SHEET NO. 13 OF 38	

PRINTED: 10/27/2014 3:25 PM R:\316 Alan Plummer\11th Street Odor Control Facility\SHS\DC-003 OOR CONTROL SYSTEM SECTIONS.dwg SAVED: 10/27/2014 3:04 PM SAVED BY: AKHTER HUSSAIN

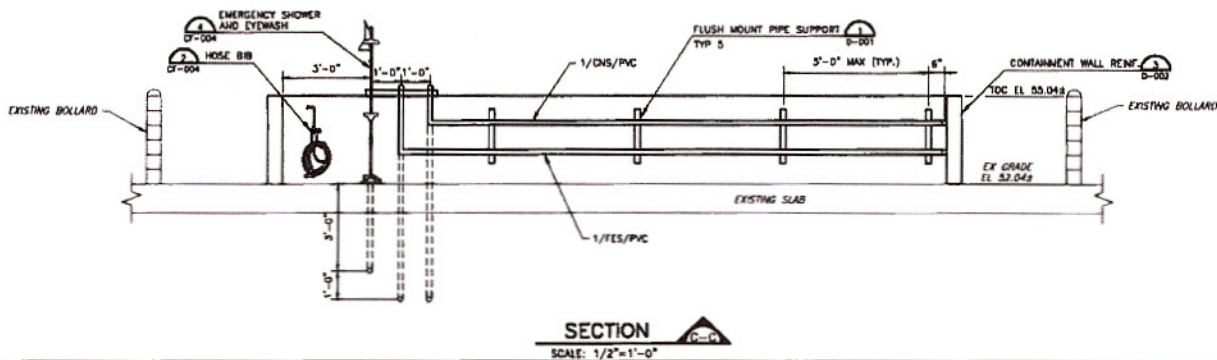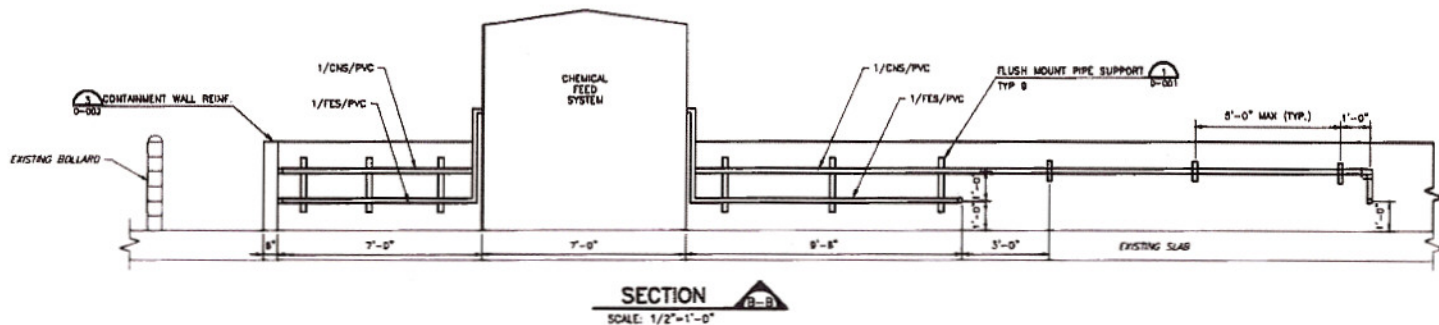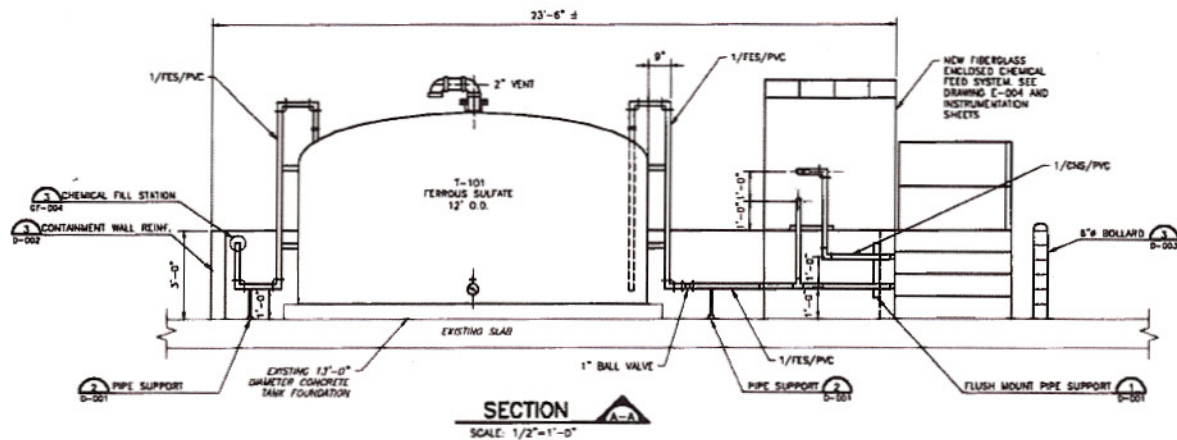

1/2" = 1'-0"

NOTES:

- CONTRACTOR SHALL COORDINATE PIPE CONNECTIONS WITH CHEMICAL FEED SYSTEM AND ENCLOSURE MANUFACTURER.

NO.	DATE	REVISION	BY
1	11/27/04	01	

DATA NO.: 1102-004-02 DRAWN BY: [ ]  
 ISSUE DATE: [ ] CHECKED BY: [ ]

TO ARRANGE FOR LINES TO BE TURNED OFF OR MOVED, CALL CENTERPOINT AT 713-207-2222.

PRIVATE UTILITY LINES SHOWN

AT LEAST 48 HOURS BEFORE DIGGING IN STREET R.S.W. OR ENGINEER'S CALL THE LONG STAR NOTIFICATION 713-253-4343

Date: [ ]  
 CenterPoint Energy/Electric Facilities  
 Signature indicates underground electric lines are properly shown. No approval for construction in place.

Date: [ ]  
 Approved for SDG underground conduit facilities only. Signature valid for one year.

Date: [ ]  
 CenterPoint Energy/Gas Facilities/TAMTEX Incorporated  
 (Gas service lines are not shown)

CABLE COMPANY

SURVEYED BY: FB NO. 00000

ALAN PLUMMER ASSOCIATES, INC.

**CITY OF HOUSTON**  
 DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

**11TH STREET ODOR CONTROL FACILITY**  
**CHEMICAL FEED SYSTEM AREA PLAN**  
 CHEMICAL FEED SYSTEM

WBS NUMBER	FOR CITY OF HOUSTON USE ONLY
R-000020-0010-4	
DRAWING SCALE	
NOT TO SCALE	
CITY OF HOUSTON PW	
ARCHIT. HUSSAIN, P.E.	
DWG NO.: EF-003	
SHEET NO. 9 OF 38	